

Topic Skills Practice Cover Sheet

Unit Name:	UEEEL0012 Install low voltage wiring, appliances, switchgear and associated accessories
Topic Title:	Aerial Cabling

Skill Practice Number:	6.2
Skill Practice Name:	Install and Connect Aerial Consumer Mains

Student Name:	
Student ID:	
College/Campus:	
Group:	

Results	
Planning:	
Carryout:	
Completion:	
Overall Results:	
Comments:	

Topic Skills Practice 6.2

UEEEL0012 Install low voltage wiring, appliances, switchgear and associated accessories

Topic 6. Aerial Cabling

Skills Practice 6.2: Install and Connect Aerial Consumer Mains

Task:

To install and connect unprotected consumer mains to an overhead service in accordance with AS/NZS 3000:2018 and local service rules requirements.

Objectives:

At the completion of this skills practice, you should be able to:

- Identify AS/NZS 3000:2018 and local service rules requirements for the installation and connection of overhead services.
- Terminate aerial conductors in accordance with AS/NZS 3000:2018 and local service rules.
- Install unprotected consumer mains in accordance with AS/NZS 3000:2018 and local service rules.
- Test consumer mains to verify continuity.
- Test consumer mains to verify the integrity of cable insulation.

Topic Skills Practice 6.2

1. Planning the Skills Practice

1.1 Equipment

- Hand tools
- Riser bracket(s)
- Aerial cabling
- Service connectors
- Consumer’s mains cabling
- Wiring enclosure/support

1.2 Suggested Materials

- 25 mm² LV Al ABC
- 16 mm² X90-UV SDI
- HD PVC corrugated conduit
- HD PVC rigid conduit
- Al-Cu IPCs

1.3 Miscellaneous Items




- PPE
- Pens/pencils
- AS/NZS 3000:2018
- Local Service and Installation Rules

1.4 Risk Assessment

Risk assessment procedure:

- Identify any hazards that may exist with this skills practice below
- List the supervision level you will be working under - Direct (D), General (G) or Broad (B)
- List the risk classification – High Risk (H), Medium Risk (M) or Low Risk (L)
- List the control measures required for each identified hazard that you need to implement.

Hazard/s Identified	Supervision Level (D, G or B)	Risk Classification (H, M or L)	Control Measure/s

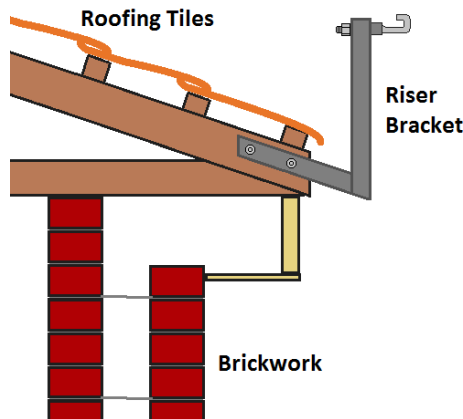
	 Feedback Have your teacher/trainer check your risk assessment	Teacher/Trainer Initials and Date <hr style="width: 100%;"/>	
---	--	--	---

Topic Skills Practice 6.2

2. Carrying Out the Skills Practice




2.1 Install and Connect Consumer Mains to an Overhead Service

2.1.1 Install riser bracket(s) to the side of the structure, ensuring compliance with minimum ground clearances as required by AS/NZS 3000:2018 and your local service and installation rules. An indicative diagram is included below:

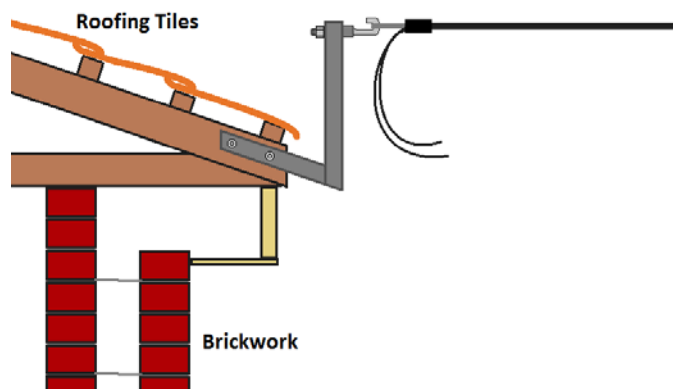





Minimum Ground Clearance: _____

Reference(s): _____

	 Feedback Have your teacher/trainer check your work	Teacher/Trainer Initials and Date	

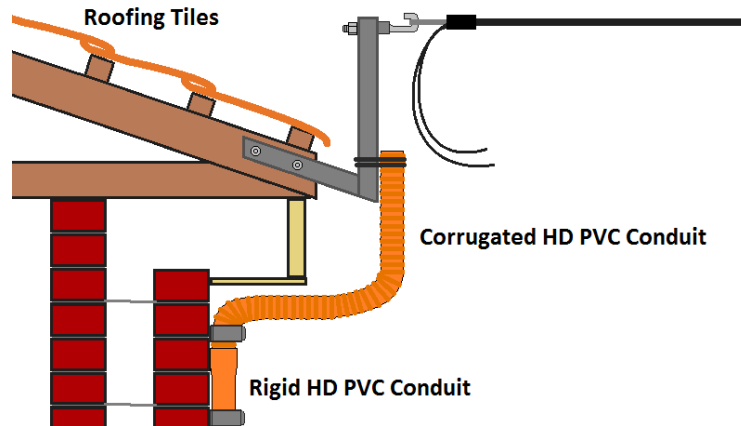
2.1.2 Install the overhead service, terminating at the riser bracket in accordance with AS/NZS 3000:2018 and your local service and installation rules. An indicative diagram is included below:






	 Feedback Have your teacher/trainer check your work	Teacher/Trainer Initials and Date	

Topic Skills Practice 6.2

2.1.3 Install wiring enclosure/supports for unprotected consumer's mains cabling in accordance with AS/NZS 3000:2018 requirements. An indicative diagram is included below:



	 <i>Feedback</i>	Have your teacher/trainer check your work	Teacher/Trainer Initials and Date	




2.1.4 Draw in the consumer's mains between the installation main switchboard and the point of attachment (POA).

2.1.5 Select an appropriate meter and test the consumer's mains to verify continuity of conductors. Record details of the test in the following table:

Meter		Results	
Type:		Active:	
Range:		Neutral:	

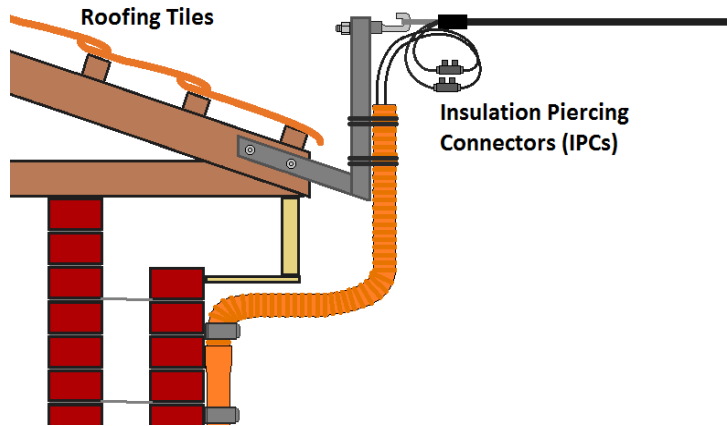
2.1.6 Select an appropriate meter and test the consumer's mains to verify the integrity of the cable insulation. Record details of the test in the following table:




Meter		Results	
Type:		A-E:	
Range:		N-E:	

	 <i>Feedback</i>	Have your teacher/trainer check your work	Teacher/Trainer Initials and Date	

Topic Skills Practice 6.2

2.1.7 Terminate the installation consumer's mains to the aerial service conductors using approved service connectors.



	 <i>Feedback</i>	Have your teacher/trainer check your work	Teacher/Trainer Initials and Date	

3. Completing the Skills Practice

3.1 Skills Practice Review Questions

3.1.1 Clean your work area, return all equipment to the correct storage areas as directed by your teacher, and then complete the following questions, using AS/NZS 3000:2018 and your local service and installation rules.



- Briefly explain AS/NZS 3000:2018 requirements and your local service and installation rules concerning installation methods for un-protected consumer's mains.

Topic Skills Practice 6.2

2. According to your local service and installation rules, what are the minimum clearances required at the point of attachment?

3. According to your local service and installation rules, what types of cables are used in your area to provide a single phase 100 A service to an installation?

4. According to your local service and installation rules, what is the maximum span for an overhead service?

	 Feedback	Have your teacher/trainer check your answers	Teacher/Trainer Initials and Date	